



METHODOLOGY FOR THE QUANTIFICATION,
MONITORING, REPORTING AND VERIFICATION OF
GREENHOUSE GAS EMISSIONS REDUCTIONS AND
REMOVALS FROM

ADVANCED REFRIGERATION SYSTEMS

VERSION 2.1

August 2021

METHODOLOGY FOR THE QUANTIFICATION, MONITORING, REPORTING AND VERIFICATION OF GREENHOUSE GAS EMISSIONS REDUCTIONS AND REMOVALS FROM ADVANCED REFRIGERATION SYSTEMS

VERSION 2.1

August 2021

ACRSM

OFFICE ADDRESS

c/o Winrock International
204 E. 4th Street
North Little Rock, Arkansas 72114 USA
ph +1 571 402 4235

ACR@winrock.org

arcarbon.org

ABOUT ACRSM

ACR is a leading global carbon crediting program operating in regulated and voluntary carbon markets. Founded in 1996 as the first private voluntary greenhouse gas (GHG) registry in the world, ACR creates confidence in the integrity of carbon markets to catalyze transformational climate results. ACR ensures carbon credit quality through the development of environmentally rigorous, science-based standards and methodologies as well as oversight of carbon offset project verification, registration, and credit issuance and retirement reporting through its transparent registry system. ACR is governed by Environmental Resources Trust LLC, a wholly-owned nonprofit subsidiary of Winrock International.

© 2021 ACR at Winrock International. All rights reserved. No part of this publication may be reproduced, displayed, modified or distributed without express written permission of the ACR. The sole permitted use of the publication is for the registration of projects on the ACR. For requests to license the publication or any part thereof for a different use, write to the Washington DC address listed above.

Acknowledgements

This methodology was developed by:



Dentons, U.S., LLC



In cooperation with:



Susan Wood Consulting



True Manufacturing

Acronyms and Definitions

If not explicitly defined here, the current definitions in the latest version of the ACR Standard apply.

TERM	ACRONYM (if applicable)	DEFINITION
Ammonia	NH ₃	A chemical compound composed of nitrogen and hydrogen. Can be used as a low-GWP refrigerant.
Advanced refrigeration system		A refrigeration system deploying advanced technology that uses low-GWP refrigerants instead of CFCs, HCFCs, or HFCs as a refrigerant.
Carbon Dioxide	CO ₂	A chemical compound composed of two oxygen atoms and a single carbon atom. Can be used as a low-GWP refrigerant.
Carbon dioxide equivalent	CO ₂ e	A standard unit of measure to express the impact of each different greenhouse gas in terms of the amount of CO ₂ that would create the same amount of global warming.
Carbon offset credits	Offsets	A carbon offset is a reduction in emissions of carbon dioxide or greenhouse gases made in order to compensate for or to offset an emission made elsewhere.
Cascade Refrigeration System		Similar to a secondary refrigeration system, a cascade system employs dual cycles, and utilizes a heat exchanger and two types of refrigerants. This enables the system to achieve

TERM	ACRONYM (if applicable)	DEFINITION
		colder temperatures that may not be achievable through primary or secondary refrigerant systems.
Chlorofluorocarbon	CFC	A class of compounds of carbon, hydrogen, chlorine, and fluorine that are commonly used as refrigerants.
End-of-Life	EOL	Emissions resulting from the disposal of refrigeration products and refrigerant.
GHG Source, Sink, or Reservoir	SSR	<ul style="list-style-type: none"> ● GHG Source – Physical unit or process that releases a GHG into the atmosphere ● GHG Sink – Physical unit or process that removes a GHG from the atmosphere ● GHG Reservoir - Physical unit or component of the biosphere, geosphere or hydrosphere with the capability to store or accumulate a GHG removed from the atmosphere by a GHG sink or captured from a GHG source.
Global warming potential	GWP	An index that attempts to integrate the overall climate impacts of a specific action (e.g., emissions of CH ₄ , NO _x or aerosols). It relates the impact of emissions of a gas to that of emission of an equivalent mass of CO ₂ .
Hydrocarbon	HC	A class of compounds containing only hydrogens and carbons (e.g., propane, isobutene, propylene). Certain HCs can be used as low-GWP refrigerants.

TERM	ACRONYM (if applicable)	DEFINITION
Hydrochlorofluorocarbon	HCFC	A class of compounds of carbon, hydrogen, chlorine, and fluorine that are commonly used as refrigerants.
Hydrofluorocarbon	HFC	A class of compounds that contain carbon, fluorine, and hydrogen that are commonly used as refrigerants, as well as solvents, aerosol propellants, and foam blowing agents.
Hydrofluoroolefins	HFO	A class of compounds composed of hydrogen, fluorine, and carbon. This class of compounds can be used as low-GWP refrigerants. Some HFO refrigerants are comprised of a mix of HFOs, referred to as an HFO blend.
HFC Refrigerant		Refrigerant comprised of either a mix of hydrofluorocarbons (HFCs) referred to as an “HFC blend”, or a single HFC.
Large Commercial Refrigeration		Equipment used to store and display chilled and frozen goods for commercial sale such as in food retailers, supermarkets, convenience stores, bakeries, and restaurants. For the purposes of this methodology, this includes commercial refrigeration units with an initial charge of 50 lbs or more of refrigerant.
Low-GWP		For the purposes of this methodology, a GWP <15 is considered low-GWP.

TERM	ACRONYM (if applicable)	DEFINITION
Project activity		Projects that avoid the emissions of CFC, HCFC, or HFC gases through the deployment of an advanced refrigeration system using a SNAP approved low-GWP refrigerant in Large Commercial Refrigeration, Remote Condensing Unit or Stand-alone Commercial Refrigeration systems. See Applicability Conditions in Section 1.2.
Project Start Date		The date that the advanced refrigeration system(s) became operational and, therefore began to reduce GHG emissions against the baseline.
Refrigeration equipment		An Appliance ¹ , or component parts of a system, that uses refrigerant to provide cooling under controlled conditions.
Secondary Loop Refrigeration System		An advanced refrigeration system where a heat transfer medium (e.g., glycol) is used in conjunction with a primary refrigerant.
Significant New Alternative Policy	SNAP	The U.S. Environmental Protection Agency's (EPA) SNAP program implements section 612 of the amended Clean Air Act of 1990, which requires EPA's continuous review of alternatives to find those that pose less overall risk to human health and the environment. Through these evaluations, SNAP generates lists of acceptable and unacceptable substitutes for each of the major industrial use

¹ Per 40 CFR §82.3, an “Appliance” is defined as “any device which contains and uses a refrigerant, and which is used for household or commercial purposes, including, without limitation, any refrigerator, chiller, or freezer.”

TERM	ACRONYM (if applicable)	DEFINITION
		sectors. The intended effect of the SNAP program is to promote a smooth transition to safer alternatives.
Stand Alone Commercial Refrigeration		Refrigerators, freezers, reach-in coolers (either open or with doors), and refrigerated food processing and dispensing equipment where all refrigeration components are integrated, and, for the smallest types, the refrigeration circuit is entirely brazed or welded. These systems are fully charged with refrigerant at the factory and typically require only an electricity supply to begin operation.

Contents

ACKNOWLEDGEMENTS.....	3
ACRONYMS AND DEFINITIONS.....	4
CONTENTS	9
1 BACKGROUND AND APPLICABILITY.....	11
1.1 SUMMARY DESCRIPTION OF THE METHODOLOGY.....	11
1.2 APPLICABILITY CONDITIONS.....	13
1.3 REPORTING PERIODS.....	14
1.4 CREDITING PERIOD	14
1.5 PERIODIC REVIEWS AND REVISIONS.....	14
2 PROJECT BOUNDARIES.....	15
2.1 GEOGRAPHIC BOUNDARY	15
3 BASELINE DETERMINATION AND ADDITIONALITY	19
3.1 BASELINE DETERMINATION	19
3.2 ADDITIONALITY ASSESSMENT	25
3.2.1 REGULATORY SURPLUS TEST.....	25
3.2.2 PRACTICE-BASED PERFORMANCE STANDARD	26
4 QUANTIFICATION OF GHG EMISSION REDUCTIONS.....	27
4.1 BASELINE EMISSIONS	27
4.2 PROJECT EMISSIONS	28
4.3 LEAKAGE	29
4.4 PROJECT EMISSION REDUCTIONS	29
5 MONITORING AND DATA COLLECTION.....	30
5.1 DESCRIPTION OF THE MONITORING PLAN.....	30
5.2 DATA COLLECTION AND PARAMETERS TO BE MONITORED	30
5.2.1 PARAMETERS MONITORED.....	31
APPENDIX A: PERFORMANCE STANDARD DEVELOPMENT AND BASELINE DATA INPUTS.....	35

APPENDIX B: REFERENCES38

FIGURES

Figure 1: Project Boundary Diagram for Advanced Refrigeration Systems 15

TABLES

Table 1: Eligible Refrigerant Sectors and Segments..... 12

Table 2: Greenhouse Gases and Sources..... 16

Table 3: Select Low-GWP Alternatives..... 20

Table 4: Baseline Default Assumptions for Advanced Refrigeration Projects 21

Table 5: Baseline Refrigerant (GWP) for Stand-Alone Commercial Refrigeration 23

Table 6: Baseline Refrigerant (GWP) for Large Commercial Refrigeration and Remote Condensing Units
..... 24

Table 7: P&S Market Survey Data on Charge Size 36

Table 8: Annualized Emission Rates for HFCs 37

EQUATIONS

Equation 1 27

Equation 2 28

Equation 3 29

1 Background and Applicability

1.1 Summary Description of the Methodology

Modern society is dependent on refrigeration to process, store and transport food, as well as on air conditioning in the built environment and motor vehicles. Reliable and cost-effective cooling is also critical for other commercial and industrial processes, such as in pharmaceutical and chemical production, oil refining, aerospace and defense technologies, data servers, and ice rinks. These diverse applications typically rely on refrigerants, the chemical coolants that can reach low temperatures and transfer heat by undergoing a phase change between liquid and gas (through condensation).

Up until the mid-1990s, chlorofluorocarbons (CFCs) were in widespread use as refrigerants. CFCs destroy the Earth's protective ozone layer and are also powerful greenhouse gases (GHGs). Under the Montreal Protocol and United States Clean Air Act, nearly all CFC production ended in the United States in 1996.² As a result, many applications transitioned to using hydrochlorofluorocarbon (HCFC) refrigerants, which also contribute to ozone depletion and climate change, although to a lesser extent than CFCs. With the phase out of HCFCs currently underway, the most commonly used refrigerants today are hydrofluorocarbons (HFCs). HFCs, while safe for the ozone layer, are also powerful GHGs when released to the atmosphere.

Across the various refrigeration and air conditioning applications, there are a number of approaches that can be used to reduce GHG emissions from both new and installed equipment. This Methodology focuses on reductions from new equipment, as described below.

For limited applications, some businesses are using alternatives to HFC refrigerants with little or no global warming potential (GWP) as they manufacture and install new refrigeration systems. These alternatives include hydrocarbons, ammonia, carbon dioxide, and hydrofluoroolefins (HFOs). In some advanced commercial refrigeration systems, these alternatives completely replace the use of HFC refrigerants, while in other advanced systems these alternatives are used in combination with HFCs.

² After 1996, the Montreal Protocol authorized limited production of CFCs for "essential uses" as propellants in medical devices (metered dose inhalers relied upon by asthmatics) and for laboratory and analytical uses. Production for essential medical uses ended in the U.S. on January 1, 2012. The exemption for de minimis CFC production essential laboratory and analytical uses remains in effect.

For example, secondary loop and cascade refrigeration systems used in supermarkets often use HFC refrigerants in combination with refrigerants that have lower GWPs (such as carbon dioxide) or heat transfer medium (such as glycol). These types of systems are eligible under this Methodology.

Table 1: Eligible Refrigerant Sectors and Segments³

SEGMENT	ELIGIBLE SEGMENTS IN SECTOR
Large Commercial Refrigeration	Equipment used to store and display chilled and frozen goods for commercial sale such as in supermarkets, convenience stores, bakeries, and restaurants. For the purposes of this methodology, this includes commercial refrigeration units with an initial charge of 50 lbs or more of refrigerant.
Remote Condensing Units	Remote condensing units have typical refrigerating capacities from 1 kW to 20 kW (0.3 to 5.7 refrigeration tons) and are composed of one (and sometimes two) compressor(s), one condenser, and one receiver assembled into a single unit, which is normally located external to the sales area. The condenser (and often other parts of the system) is located outside the space or area cooled by the evaporator, typically ejecting heat to the outdoor ambient environment. Remote condensing units are commonly installed in convenience stores, specialty shops (e.g., bakeries, butcher shops), supermarkets, restaurants, and other locations where food is stored, served or sold.
Stand-Alone Commercial Refrigeration	Refrigerators, freezers, reach-in coolers (either open or with doors), and refrigerated food processing and dispensing equipment where all refrigeration components are integrated, and, for the smallest types, the refrigeration circuit is entirely brazed or welded. These systems are fully charged with refrigerant at the factory and typically require only an electricity supply to begin operation.

This Methodology provides the quantification framework for the creation of carbon offset credits from the reductions in GHG emissions resulting from transitioning to advanced refrigeration systems in the eligible sectors. The Methodology is intended to be used as an incentive within the relevant industries to increase these activities.

This Methodology is based on a robust data set, including the United States EPA Inventory of U.S. Greenhouse Gas Emissions and Sinks (1990-2019), United Nations Environment Programme Technical Options Committee for Refrigeration, Air Conditioning and Heat Pumps, the United States EPA

³ For a general discussion of advanced refrigeration systems, see the United States EPA discussion here: <http://www2.epa.gov/greenchill/advanced-refrigeration>

GreenChill Partnership, and the 2006 International Panel on Climate Change Guidelines for Greenhouse Gas Inventories.

1.2 Applicability Conditions

For the purposes of this Methodology, projects that avoid the emissions of CFC, HCFC, or HFC gases in the following activity are considered a “project activity”:

- Deployment of an advanced refrigeration system using a SNAP-approved low-GWP refrigerant in Large Commercial Refrigeration, Remote Condensing Units or Stand-alone Commercial Refrigeration systems.

For purposes of this Methodology, a Large Commercial Refrigeration project activity may comprise of (i) the complete replacement of CFC, HCFC or HFC-based equipment (including all components) with an advanced refrigeration system at an existing facility, (ii) the installation of an advanced refrigeration system as a new and additional system at an existing facility, or (iii) the installation of an advanced refrigeration system in new construction.

In addition to satisfying the ACR program eligibility requirements as found in the latest ACR Standard, project activities must satisfy the following conditions for this Methodology to be applicable:

- I. The project is located in United States, Canada or Mexico.
- II. The project is within a sector and segment which has a low adoption rate for the relevant project activity (“Eligible Project Activity” & “Eligible Refrigerant Sector/Segment” (see Table 1)).
- III. For a project activity that involves replacement of CFC, HCFC, or HFC-based equipment with an advanced refrigeration system where the original equipment is decommissioned, any CFCs or HCFCs in the original equipment must be recovered and destroyed in accordance with ACR or the California Air Resource Board ODS Destruction Methodology and any HFCs must be managed in accordance with EPA regulations (40 CFR Part 82, Subpart F) under Section 608 of the Clean Air Act⁴.

⁴ EPA regulations (40 CFR Part 82, Subpart F) under Section 608 of the Clean Air Act restrict the resale of used ozone depleting and HFC refrigerant to a new owner unless it has been reclaimed by an EPA-certified refrigerant reclaimer. Refrigerant that has been recovered and/or recycled can be returned to the same system or other systems owned by the same person without being reclaimed.

- IV. Any refrigerant used in the advanced refrigeration system must be an acceptable substitute according to United States EPA Significant New Alternatives Policy (SNAP) program for use in commercial refrigeration end-uses and be used in accordance with SNAP use conditions.⁵

1.3 Reporting Periods

- A project shall have one reporting period that shall not exceed more than 12 months in length.
- The Reporting Period begins on the Project Start Date.

1.4 Crediting Period

A Crediting Period is the finite length of time for which a GHG Project Plan is valid, and during which a project can generate offsets against its baseline scenario. The crediting period for all project activities shall be ten years. The crediting period begins on the Project Start Date.

1.5 Periodic Reviews and Revisions

ACR may require revisions to this Methodology to ensure that monitoring, reporting, and verification systems adequately reflect changes in the project's activities. This Methodology may also be periodically updated to reflect regulatory changes, emission factor revisions, or expanded applicability criteria. Before beginning a project, the project proponent should ensure that they are using the latest version of the Methodology.


⁵ <https://www.epa.gov/snap/substitutes-refrigeration-and-air-conditioning>

2 Project Boundaries

2.1 Geographic Boundary

The project boundary, depicted by the figure below, includes the physical and geographical site where the advanced refrigerant system is installed, as well as the locations involved in disposal of the older technology, including management of any previously used HFC or destruction of the CFC or HCFC refrigerant in the older system that is replaced.

Figure 1: Project Boundary Diagram for Advanced Refrigeration Systems

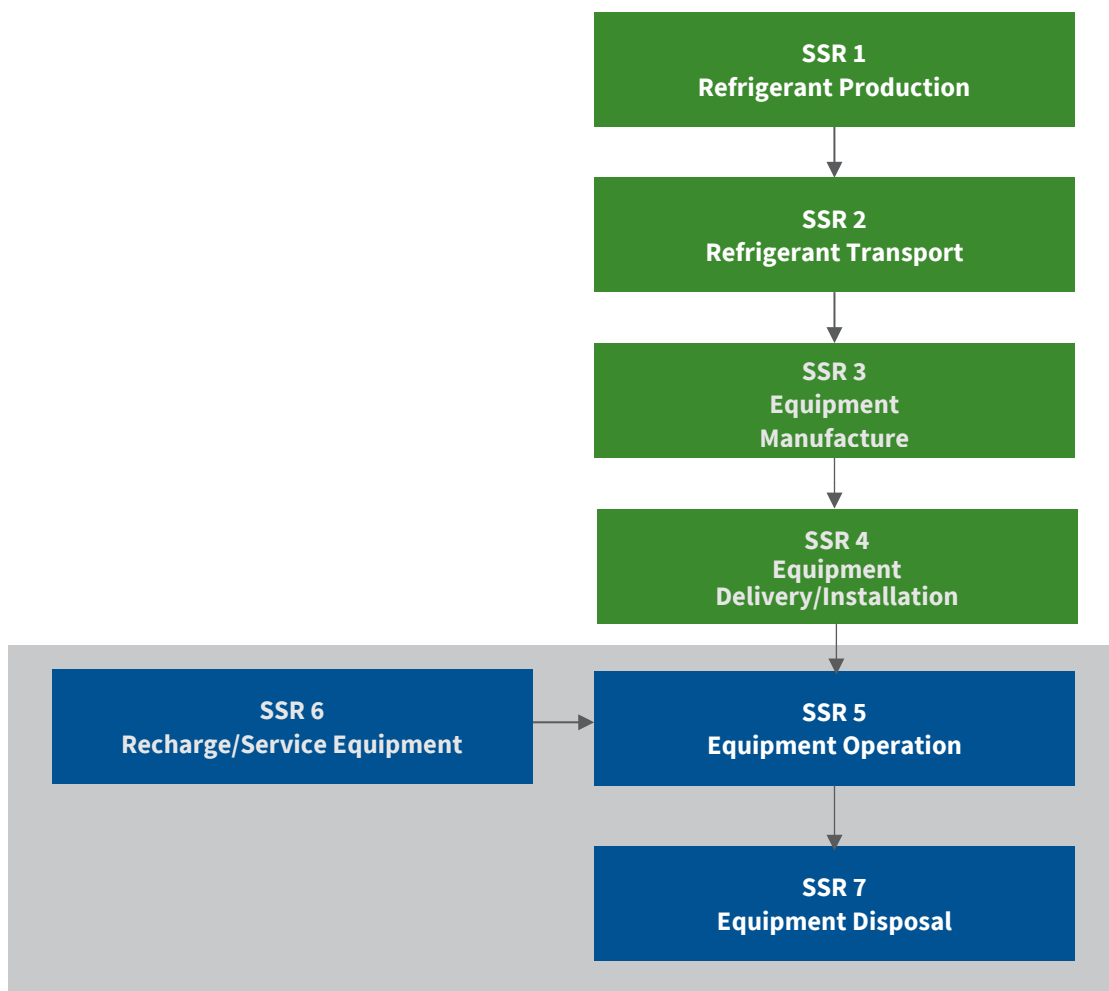

The GHG emission sources included within the project boundary are depicted in the dark blue boxes in Figure 1. They include emissions from the operation of the refrigeration equipment, emissions resulting from the recharging and servicing of that equipment, and end-of-life (EOL) / disposal emissions. Table 2 lists the GHG sources included and excluded depending on whether the sources are inside or outside project boundaries.

Table 2: Greenhouse Gases and Sources

SSR	SOURCE DESCRIPTION	GAS	INCLUDED (I) OR EXCLUDED (E)	QUANTIFICATION METHOD
1 Refrigerant Production	Fossil fuel emissions from the production of refrigerants	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A
	Refrigerant leaks during production	HFC	E	N/A
		Low GWP Refrigerant	E	N/A
2 Refrigerant Transport	Fossil fuel emissions from transport of refrigerants	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A
	Refrigerant leaks during transport	HFC	E	N/A
		Low GWP refrigerant	E	N/A
3 Equipment Manufacture	Fossil fuel emissions from the operation of the refrigeration system in the baseline and the project.	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A

SSR	SOURCE DESCRIPTION	GAS	INCLUDED (I) OR EXCLUDED (E)	QUANTIFICATION METHOD
4 Equipment Delivery and Installation	Fossil fuel emissions from the delivery and installation of the advanced refrigeration system.	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A
5 Equipment Operation	Fossil fuel emissions from the operation of the refrigeration system in the baseline and the project.	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A
	Refrigerant leaks from the operation of the refrigeration system in the baseline and the project.	CFC	I	See Table 4
		HCFC	I	See Table 4
		HFC	I	See Table 4
		Low GWP refrigerant	I	See Table 4
6 Equipment Service/Recharges	Fossil fuel emissions from servicing refrigeration or A/C equipment or system to replace leaked refrigerant	CO ₂	E	N/A
		CH ₄	E	N/A
		N ₂ O	E	N/A
	Refrigerant emissions occurring from servicing refrigeration or A/C equipment or system to replace leaked refrigerant	HFC	I	See Table 4
		Low GWP Refrigerant	I	See Table 4

SSR	SOURCE DESCRIPTION	GAS	INCLUDED (I) OR EXCLUDED (E)	QUANTIFICATION METHOD
7 EOL/ Equipment Disposal	Emissions from the disposal of the equipment at end-of-life (EOL), including destruction of refrigerant.	CO ₂	E	N/A
		CH ₄	E	N/A
		CFCs	I	See Table 4
		HCFC	I	See Table 4
		HFCs	I	See Table 4

3 Baseline Determination and Additionality

3.1 Baseline Determination

The baseline for a project activity is determined utilizing industry standards and represents the most commonly used practices and technologies.

Food retailers rely heavily on various types of refrigeration systems such as centralized compressor racks that provide cooling throughout the stores via an extensive network of pipes and valves, distributed racks, walk-in coolers, stand-alone units, and beverage refrigerators. Refrigeration systems are “charged” with refrigerant, either at the manufacturing plant, or at the facility where a system is installed (e.g., a supermarket or other food retailer). These systems tend to leak and release refrigerant during normal operations and servicing. The leak rate is dependent upon the type of refrigeration system and is the basis for determining the annual emission rate used in this Methodology.

Under normal operating conditions, depending on the type of equipment and the location, between 1 and 50% of the refrigerant in stationary refrigeration systems leaks each year (ICF 2016; IPCC, 2006; RTOC 2010; EPA, 2015; ACR ODS Destruction Methodology 2017). Inventory of US greenhouse gas emissions and sinks: 1990-2019 states that HFC emission rates from servicing and leaks range from 0.5% to 36.4% annually depending on the type of end-use⁶. Even with active leak detection and aggressive maintenance efforts, it is difficult to eliminate leaks completely. Consequently, to maintain proper performance, leaky equipment and systems require periodic servicing to replace the lost refrigerant. Additionally, refrigerants are released at EOL if the refrigerants are not recovered prior to destruction.

For the purposes of determining the annual leak rates, data from the Table A-131 of the Inventory of US greenhouse gas emissions and sinks: 1990-2019⁶ is used. The inventory includes an industry-wide average annual HFC emission rate (from servicing and leaks) of 25% for large commercial refrigeration units, 11.5% for remote condensing units and a 1% for stand-alone-units. The HFC emission rates during “first fill” and at disposal or end of life (EOL) – as included in the inventory – are listed in Table

⁶ [Inventory of U.S. Greenhouse Gas Emissions and Sinks: 1990-2019 – Annex 3 Part A \(epa.gov\)](#)

9. This methodology includes first-fill and EOL emissions by amortizing these refrigerant losses over the 10-year crediting period.

The industry has historically relied on R-404a, R-407a, and HFC-134a. However, with the introduction of EPA SNAP rules 20 and 21⁷, several states have introduced legislation to ban use of refrigerants listed in SNAP rules 20 and 21 and encourage transition to alternatives listed in SNAP rule 21. In a small number of cases, supermarkets and food retailers have installed advanced refrigeration systems with non-HFC refrigerants with zero or low-GWP such as CO₂, HCs, and ammonia (see Table 3).

Table 3: Select Low-GWP Alternatives

LOW-GWP SNAP-APPROVED REFRIGERANT	GLOBAL WARMING POTENTIAL
R-290 (propane)	3
R-600a (isobutane)	3
R-1270 (propylene)	1.8
R-744 (CO ₂)	1
R-717 (ammonia)	0

These advanced refrigeration systems that utilize non-HFC and/or low GWP refrigerants encompass a wide variety of designs, including use of one refrigerant throughout the entire system, or for example, secondary loop systems where the compressor uses a relatively small charge of HFC refrigerant, and the piping throughout the store is filled with heat exchange fluid such as glycol.

This Methodology includes scenarios where advanced refrigeration systems are installed in both new and existing commercial facilities. A measure of the penetration rate of these advanced refrigeration systems is the number of food retailers certified by EPA’s GreenChill Partnership as having a “platinum” rating. The GreenChill platinum certification does not meet the definition of an advanced refrigeration system, as defined by this Methodology, due to the 150 GWP refrigerant threshold⁸. However, it is demonstrative of the low market adoption rate of low-GWP refrigerants. As of December

⁷ [SNAP Regulations | Significant New Alternatives Policy \(SNAP\) Program | US EPA](#)

⁸ Food retailers qualify for GreenChill platinum certification by either 1) having a refrigeration system that uses a refrigerant with a GWP less than 150, or 2) having a very small HFC refrigerant charge (less than 0.5 lbs per MBTU/hr total evaporator heat load) and achieving an annual leak rate of 5% or less.

2020, of the more than 38,500 food retailers in the U.S., only four hundred and nineteen (419), or 1.09%, are certified as platinum by GreenChill⁹.

Tables 4, 5 and 6 list the default baseline factors in projects involving new commercial refrigeration systems. With states introducing their own legislations prohibiting refrigerants (as per SNAP rules 20 and 21) with different effective dates, the default baseline refrigerants (GWPs) are state and date specific. The default baseline refrigerants or GWPs are based on acceptable alternates (as per SNAP rules 20, 21 and 23) for a particular vintage year or part of that year. For Stand-Alone Commercial Refrigeration, the highest GWP acceptable alternate or GWP limit (for Canada) is used. For Large Commercial Refrigeration and Remote Condensing Units, R-407A (for states where R-404A is banned) or GWP limit (for Canada) is used. These default assumptions shall be applied in Equations 1 and 2 of Section 4.1.

Table 4: Baseline Default Assumptions for Advanced Refrigeration Projects

SEGMENT	EQUIPMENT	CHARGE SIZE (KG) ¹⁰	BASELINE REFRIGERANT ¹¹	ANNUAL AMORTIZED EMISSION RATE ¹²
Large Commercial Refrigeration	Commercial Refrigeration with initial refrigerant charge size of 50 lbs or more	1.16 kgs refrigerant per MBTU/hr of cooling capacity of the new system	Refer to Table 6	25.67%
Remote Condensing Unit	Commercial Refrigeration with separate condensing unit	1.3 kgs per ton of cooling capacity of a new system	Refer to Table 6	12.62%

⁹ [GreenChill Certified Stores | GreenChill Partnership | US EPA](#)

¹⁰ P&S Research provided the market research for charge sizes (see Appendix A, Table 8).

¹¹ The potential future applicability of EPA's SNAP 20 and SNAP 21 shall be considered in light of EPA rulemaking following the decision by the Court of Appeals for the District of Columbia in No. 15-1328, 866 F3rd 451 (2017 and Executive Order 13783 (March 28, 2017, 82 FR 16093-97) and any other state or local regulations not included in Tables 5 and 6 (with respect to refrigerant use limitations, and addressed through addendums or revisions to this methodology, as needed.

¹² The annual amortized emission rate includes the “first-fill” and EOL emissions by amortizing these refrigerant losses over the 10-year crediting period. See Appendix A “Baseline Systems Data”.

SEGMENT	EQUIPMENT	CHARGE SIZE (KG) ¹⁰	BASELINE REFRIGERANT ¹¹	ANNUAL AMORTIZED EMISSION RATE ¹²
Stand-Alone Commercial Refrigeration	Vertical Closed Refrigerators	1.3	Refer to Table 5	7.20%
	Vertical Closed Freezers	1.7		
	Vertical Open Refrigerators	1.1		
	Horizontal Open Refrigerator	0.8		
	Horizontal Open Freezer	1.0		
	Deli Cases Refrigerator	0.6		
	Drink Dispensing	0.85		
	Ice Machines	0.85		
	Soft Serve Ice Cream and Frozen Beverages	1.125		
	Food Prep Tables	0.55		
	Blast Chillers	1.25		

Table 5: Baseline Refrigerant (GWP) for Stand-Alone Commercial Refrigeration

SEGMENT	US STATE(S)/ COUNTRIES	BASELINE REFRIGERANT (GWP)		
		2019	2020	2021 ¹³
Stand-Alone Commercial Refrigeration	California	1453 (A) 2053 (B)	850 (C)	773 (D) 1306 (E)
	Washington	2053	850	773 1306
	Colorado, Delaware, Maryland, Massachusetts, New Jersey, New York, Vermont	2053	2053	773 1306
	All other US States and Territories	2053	2053	1962
	Canada	2053	1425 (F)	1425
	Mexico	2053	2053	1962

(A) Stand-Alone Medium-Temperature Units with a compressor capacity below 2,200 Btu/hour and not containing a flooded evaporator (New); R-513A (75%) and R-404A (25%)

(B) Stand-Alone Medium-Temperature Units with a compressor capacity equal to or greater than 2,200 Btu/hour and Stand-Alone Medium-Temperature Units containing a flooded evaporator (New); HFC-134A (75%) and R-404A (25%)

(C) R-513A (75%) and R-426A (25%)

¹³ AR5 100-year GWP values are used for year 2021 as per ACR standard 7.0

- (D) Up to June 6, 2021; R-513A (75%) and R-426A (25%)
- (E) After June 6, 2021; Average of R-448A, R-449A, R-449B (75%) and R-426A (25%)
- (F) GWP limit for medium temperature units: 1400 (75%) and GWP limit for low temperature units: 1500 (25%)

Table 6: Baseline Refrigerant (GWP) for Large Commercial Refrigeration and Remote Condensing Units

SEGMENT	US STATE(S)/ COUNTRIES	BASELINE REFRIGERANT (GWP)		
		2019	2020	2021 ¹⁴
Large Commercial Refrigeration and Remote Condensing Units	California	2110 (G)	2110	1923
	Washington, New Jersey, Vermont	3015 (H)	2110	1923
	Colorado, Delaware, Maryland, Massachusetts, New York	3015	3015	1923
	All other US States and Territories	3015	3015	2934
	Canada	3015	2200 (I)	2200
	Mexico	3015	3015	2934

(G) R-407A

(H) R-407A (50%) and R-404A (50%)

¹⁴ AR5 100-year GWP values are used for year 2021 as per ACR standard 7.0

- (I) GWP limit for centralized refrigeration systems that are generally used for storing and displaying food, beverages, and other perishables in convenience stores and supermarkets, using HFCs as refrigerants.

For projects that replace an existing Large Commercial Refrigeration system, the actual refrigerant used in the system that was replaced and the refrigerant charge size of the replaced system shall be used. For these projects, data from regulatory compliance reporting or other verifiable historical operating records shall be used in Equations 1 and 2 of Section 4.1 to establish the appropriate baseline refrigerant, charge size, and annual amortized leak rates.

3.2 Additionality Assessment

Emission reductions from the project must be additional or deemed not to occur in the “business-as-usual” scenario. Assessment of the additionality of a project will be made based on passing the two tests cited below. These two tests require the project proponent to demonstrate that the project activity is surplus to regulations and reduces emissions below the level established in the Methodology.

- Regulatory Surplus Test, and
- Practice-Based Performance Standard

3.2.1 REGULATORY SURPLUS TEST

In order to pass the regulatory surplus test, a project must not be mandated by existing laws, regulations, statutes, legal rulings, or other regulatory frameworks in effect as of the project start date that directly or indirectly affect the credited GHG emissions associated with a project. The project proponent must demonstrate that there is no existing regulation that mandates the project or effectively requires the GHG emission reductions associated with installing advanced refrigeration technologies.

There are no Federal requirements in the United States that require installation of advanced refrigeration technology¹⁵. EPA issued a regulation that would have prohibited the use of several HFC blends, including R404A and R507A – in new commercial refrigeration installations beginning August 2017, but it was declared invalid by the Court of Appeals for the D.C. Circuit.¹⁶ Therefore, R404A and R507A currently remain available for use. However, starting 2019, several states have introduced legislations that prohibit use of specific refrigerants in specific end-uses. For advanced refrigeration units sold to the affected states, baseline emissions calculations will be based on new baseline GWPs provided in Tables 5 and 6.

3.2.2 PRACTICE-BASED PERFORMANCE STANDARD

In order for a project to qualify for offset credits under this Methodology it must be demonstrated that the sector has a low market adoption rate for advanced refrigeration technology. A market adoption analysis, and hence the additionality demonstration under Applicability Condition 1.2(II), was conducted for the relevant sectors and segments (see Table 1).

A review of US EPA’s GreenChill Partnership program data (see Appendix A) indicates low market adoption rates for advanced refrigeration technology across all product segments. Therefore, project activities within these sectors qualify for offset credit creation under this Methodology.

¹⁵ In December 2020, the American Innovation in Manufacturing (AIM) Act was passed, directing EPA to address the environmental impact of hydrofluorocarbons (HFCs) by: phasing down production and consumption, maximizing reclamation and minimizing releases from equipment, and facilitating the transition to next-generation technologies through sector-based restrictions. ACR conducted a review of the EPA’s first rule under the AIM Act and related regulations in Canada and Mexico enacted since this methodology’s initial adoption. As of the publication of this version, the project activity is considered additional to regulation. A description of the regulations reviewed can be found on the project page for this methodology on ACR’s website “Policy Update 2021”.

¹⁶ 80 FR 42869; July 20, 2015; Mexichem Fluor Inc. v. Environmental Protection Agency, D.C. Cir No. 15-1328 (August 2017). A rehearing on that decision was denied on January 25, 2018.

4 Quantification of GHG Emission Reductions

Quantification of project emission reductions requires calculation of baseline emissions and project emissions.

4.1 Baseline Emissions

Other than for Large Commercial Refrigeration projects that are replacing an existing system, Project Proponents shall use the default emission rates, charge rates, and GWP values listed in Table 4.

For projects that replace a Large Commercial Refrigeration system, project proponents shall use historical system-specific data for refrigerant type, charge rate of system, and annual emission rates. This data can be generated from regulatory compliance reporting and other verifiable, historical operating documentation.

Baseline emissions will be calculated according to the following formula:

Equation 1

$$BE_y = \sum_i [(Q_{BR,j,i} \div 1000) \times ERA_{REF,j} \times GWP_{REF,j}] \times 10$$

WHERE

BE_y	Baseline emissions in year y (MT CO ₂ e)
$Q_{BR,j,i}$	Quantity of refrigerant j in equipment i used in baseline system (Charge Size of equipment in kgs). Other than for Large Commercial Refrigeration projects where an existing system is being replaced, use the Refrigerant Charge Size default values in Table 4. For Large Commercial Refrigeration projects where, existing equipment is being replaced, use regulatory compliance reporting or verifiable historical operating records to establish the charge size of the replaced baseline system.

$ERA_{REF,j}$	Annual amortized emission rate of refrigerant j in baseline system (%). Other than for Large Commercial Refrigeration projects where an existing system is being replaced, use the Annual Emission Rate default values in Table 4. For Large Commercial refrigeration projects where, existing equipment is being replaced, use regulatory compliance reporting or verifiable historical operating records to establish the annual leak rate of the replaced baseline system which shall be based on the average of the previous two years of baseline system operation prior to installation of advanced refrigeration system.
10	Number of years in the crediting period ¹⁷
$GWP_{REF,j}$	Global warming potential of baseline refrigerant j . Other than for Large Commercial Refrigeration projects where an existing system is being replaced, use the GWP default values in Tables 5 and 6. For Large Commercial refrigeration projects where existing equipment is being replaced, use regulatory compliance reporting or verifiable historical operating records to establish the type of refrigerant historically used. ¹⁸

4.2 Project Emissions

Project emissions will be calculated according to the following formula:

Equation 2

$$PE_y = \sum_i [(AR_{k,i} \div 1000) \times ERA_{REF,k} \times GWP_{REF,k}] \times 10$$

WHERE

PE_y	Project emissions in year y (MT CO ₂ e)
--------	---

¹⁷ All offsets for a project over the 10-year crediting period will be issued following verification.

¹⁸ For installation of a Large Commercial Refrigeration system at an existing facility, project proponents shall use the GWP of the refrigerant used in the system that is replaced. Project proponents shall apply the 100-year value for refrigerant GWPs found in the IPCC Fifth Assessment Report for the historical refrigerant used.

$AR_{k,i}$	Charge size of alternative refrigerant k used in project system from manufacturer specifications i (kgs) ¹⁹
$ERA_{REF,k}$	Annual emission rate of alternative refrigerant k set equal to emission rate for baseline system (% per year).
10	Number of years in the crediting period
$GWP_{REF,k}$	Global warming potential of alternative refrigerant k used in the project.

4.3 Leakage

By installing an advanced refrigeration system, a project is not increasing overall market demand for refrigeration systems. Thus, there would be no “market-shifting” associated with this project type. Regarding “activity-shifting” leakage, implementation of a project at an existing facility may result in the recovery of refrigerant used in the system that was replaced. However, per applicability conditions 1.2 (III) and 1.2 (IV) any refrigerant recovered in the old system must be destroyed (if CFC or HCFC) or managed in accordance with EPA regulations (40 CFR Part 82, Subpart F) under Section 608 of the Clean Air Act (if HFC). Thus, for this Methodology, leakage can be disregarded.

4.4 Project Emission Reductions

Equation 3

$$ER_y = [BE_y - PE_y]$$

WHERE

ER_y	Emission reductions in year y (MT CO ₂ e)
BE_y	Baseline emissions in year y (MT CO ₂ e)
PE_y	Project emissions in year y (MT CO ₂ e)

¹⁹ For secondary loop systems, the parameter $AR_{k,i}$ should only include the quantity of primary refrigerant used in the system.

5 Monitoring and Data Collection

Each project shall include a monitoring, reporting and verification plan sufficient to meet the requirements of the ACR Standard. The plan shall collect all data required to be monitored and in a manner which meets the requirements for accuracy and precision of this Methodology.

5.1 Description of the Monitoring Plan

These are expanded upon in the sections below. The project proponent must prepare a monitoring plan describing (for each separately) the following: a) project implementation; b) technical description of the monitoring task; c) data to be monitored and collected; d) overview of data collection procedures; e) frequency of the monitoring; f) quality control and quality assurance procedures; g) data archiving; and h) organization and responsibilities of the parties involved in all the above.

The rationale of monitoring project implementation is to document all project activities implemented by the project that could cause an increase in GHG emissions compared to the baseline scenario.

5.2 Data Collection and Parameters to be Monitored

The process for monitoring the project's emission reduction parameters includes:

- Identifying and logging the equipment/systems to be installed
- Documentation of the charge size of the alternative refrigerant used in the project from manufacturer specifications.
- For Large Commercial Refrigeration projects that are replacing existing systems, regulatory compliance reporting or verifiable historical operating records to establish the annual leak rate of the replaced baseline system which shall be based on the average of the previous two years of baseline system operation prior to installation of advanced refrigeration system.

- For Large Commercial Refrigeration projects that are replacing CFC or HCFC-based systems, documentation showing proof of destruction for the displaced CFC and HCFC. This documentation shall include the following:
 - ◆ Bills of lading for shipments of CFC or HCFC from the facility to a destruction facility²⁰
 - ◆ Attestation from project proponent and signed by representatives from the project proponent and the destruction facility that the volume of displaced CFC or HCFC from the baseline system was destroyed including the dates of destruction.
- For Large Commercial Refrigeration projects that are replacing HFC-based systems, documentation showing proof of management in accordance with EPA regulations (40 CFR Part 82, Subpart F) under Section 608 of the Clean Air Act. This documentation shall include the following:
 - ◆ Documentation of the recovery of the HFC (i.e. receipts or invoices documenting recovery by service technician) and subsequent management in accordance with EPA regulations.
 - ◆ Attestation from project proponent that the volume of displaced HFC from the baseline system was managed in accordance with EPA regulations.

5.2.1 PARAMETERS MONITORED

PARAMETER	$Q_{BR,j,i}$
UNITS	kg
DESCRIPTION	Quantity of refrigerant j in equipment i used in baseline system (charge size of equipment in kgs). Other than for Large Commercial Refrigeration projects where an existing system is being replaced, use the Refrigerant Charge size default values in Table 4. For Large Commercial Refrigeration projects where existing equipment is being replaced, use regulatory compliance reporting or verifiable historical operating records to establish the charge size of the replaced baseline system.
RELEVANT SECTION	4.1

²⁰ Destruction shall be conducted at either an approved hazardous waste combustor subject to the Resource Conservation and Recovery Act (RCRA) that maintains a current RCRA permit that states an ODS destruction efficiency of at least 99.99% or at a destruction facility that meets the Montreal Protocol’s Technology and Economic Assessment Panel standard that a destruction facility must demonstrate a destruction and removal efficiency of 99.99%.

RELEVANT EQUATION(S)	1
SOURCE OF DATA	Table 4, installation, regulatory compliance, or operating records
MEASUREMENT FREQUENCY	Determined once
PARAMETER	$AR_{k,i}$
UNITS	kg
DESCRIPTION	Quantity of alternative refrigerant k used in project system i .
RELEVANT SECTION	4.2
RELEVANT EQUATION(S)	2
SOURCE OF DATA	Manufacturer specifications
MEASUREMENT FREQUENCY	Determined once
PARAMETER	$ERA_{REF,j}$
UNITS	% per year

DESCRIPTION	Annual amortized emission rate of refrigerant j in baseline system (%). Other than for Large Commercial Refrigeration projects where an existing system is being replaced, use the annual amortized emission rate default values in Table 4. For Large Commercial refrigeration projects where, existing equipment is being replaced, the annual amortized emission rate is determined using actual annual leak rates based on the average of the verifiable operating records from the previous two years of baseline system operation prior to installation of advanced refrigeration system.
RELEVANT SECTION	4.1
RELEVANT EQUATION(S)	1
SOURCE OF DATA	Table 4, installation, regulatory compliance, or operating records
MEASUREMENT FREQUENCY	Determined once
PARAMETER	$ERA_{REF,k}$
UNITS	% per year
DESCRIPTION	Annual emission rate of alternative refrigerant k used in project system
RELEVANT SECTION	4.2
RELEVANT EQUATION(S)	2
SOURCE OF DATA	Set equal to the emission rate of the baseline system.
MEASUREMENT FREQUENCY	Determined once

PARAMETER	$GWP_{REF,k}$
UNITS	Global Warming Potential (GWP)
DESCRIPTION	GWP of alternative refrigerant k used in project system.
RELEVANT SECTION	4.2
RELEVANT EQUATION(S)	2
SOURCE OF DATA	IPCC, published governmental reference (e.g., EPA SNAP), or scientific, peer reviewed publication
MEASUREMENT FREQUENCY	Determined once

APPENDIX A: Performance Standard Development and Baseline Data Inputs

A.1 Performance Standard Development

Section 3.1 summarizes trends in the adoption of advanced refrigeration systems. A measure of the penetration rate of these newer technologies is the number of food retailers certified by EPA's GreenChill Partnership as having a "platinum" rating. The GreenChill platinum certification does not meet the definition of an advanced refrigeration system, as defined by this Methodology, due to the 150 GWP refrigerant threshold.²¹ However, it is demonstrative of the low market adoption rate of low-GWP refrigerants. As of December 2020, of the more than 38,500 food retailers in the U.S., only four hundred and nineteen (419), or 1.09%, are certified as platinum by GreenChill.²² There may be additional stores in the United States that have advanced refrigeration systems that have not yet been recognized by the EPA GreenChill Partnership. However, under any scenario, currently the percentage of supermarkets and food retailers in the United States with advanced refrigeration systems is negligible.

A.2 Baseline System Data

The charge size ranges for the various stand-alone products are based on actual market data gathered by P&S Market Research (Table 7). Average values of the size ranges are used for emissions

²¹ Food retailers qualify for GreenChill platinum certification by either 1) having a refrigeration system that uses a refrigerant with a GWP less than 150, or 2) having a very small HFC refrigerant charge (less than 0.5 lbs per MBTU/hr total evaporator heat load) and achieving an annual leak rate of 5% or less.

²² [GreenChill Certified Stores | GreenChill Partnership | US EPA](#)

calculations. Charge size for remote condensing unit is 2.5 to 3.0lbs per ton of refrigeration²³ (rated cooling capacity) based on common industry practice.

For the purposes of determining the annual amortized emission rates, data from Table A-131 of the EPA’s Inventory of U.S. Greenhouse Gas Emissions and Sinks: 2000-2019²⁴ was used. Table 8 presents the annual amortized emission rates for the three end-use categories.

Table 7: P&S Market Survey Data on Charge Size

PRODUCT	CHARGE RANGE (KGS)
Vertical Closed Refrigerators	1.2 – 1.4
Vertical Closed Freezers	1.5 – 1.9
Vertical Open Refrigerators	1.0 – 1.2
Horizontal Open Refrigerator	0.7 – 0.9
Horizontal Open Freezer	0.9 – 1.1
Deli Cases Refrigerator	0.4 – 0.8
Drink Dispensing	0.7 – 1.0
Ice Machines	0.6– 1.1
Soft Serve Ice Cream and Frozen Beverages	1.05 – 1.2
Food Prep Tables	0.4 – 0.7
Blast Chillers	1.1 – 1.4

²³ <https://norlake.com/wp-content/uploads/2020/12/Remote-Condensing-Unit-Manual.pdf>

²⁴ <https://www.epa.gov/sites/default/files/2021-04/documents/us-ghg-inventory-2021-annex-3-additional-source-or-sink-categories-part-a.pdf>

Table 8: Annualized Emission Rates for HFCs²⁵

END-USE	LIFETIME (YEARS)	HFC EMISSION RATES (FIRST-FILL) (%)	HFC EMISSION RATES (SERVICING AND LEAKS) (%)	HFC EMISSION RATES (DISPOSAL) (%)	ANNUALIZED EMISSION RATE (%)
STAND-ALONE COMMERCIAL REFRIGERATION					7.20%
Refrigerated Food Processing and Dispensing Equipment	10	1.00%	1.00%	68.00%	7.90%
Small Retail Food	10	1.00%	1.00%	42.00%	5.30%
Vending Machines	10	0.50%	1.00%	73.50%	8.40%
LARGE COMMERCIAL REFRIGERATION					25.67%
Large Retail Food	18	2.00%	25.00%	10.00%	25.67%
REMOTE CONDENSING UNITS					12.62%
Condensing Unit (Medium Retail Food)	15	1.75%	11.50%	15.00%	12.62%

²⁵ Calculated from Table A-131 of [Inventory of U.S. Greenhouse Gas Emissions and Sinks: 1990-2019 – Annex 3 Part A \(epa.gov\)](https://www.epa.gov/greenwaste/inventory-of-u.s.-greenhouse-gas-emissions-and-sinks-1990-2019-annex-3-part-a)

APPENDIX B: References

ACR (2017) Methodology for the Quantification, Monitoring, Reporting, and Verification of Greenhouse Gas Emissions from the Destruction of Ozone Depleting Substances and High-GWP Foam, United States, Version 1.1, September 2017. (ACR, 2017).

EPA (2010) Transitioning to Low-GWP Alternatives in Commercial Refrigeration.

EPA (2010) Amendments to the Section 608 Leak Repair Requirements, Notice of Proposed Rulemaking, 75 FR 78558 – 78583, December 15, 2010.

EPA (2011) EPA Vintaging Model, Version VM IO file_v4.4_3.23.11, as cited in CAR (2012).

EPA (2020) Summary of Refrigerant Reclamation Trends. <https://www.epa.gov/section608/summary-refrigerant-reclamation-trends>

EPA (2015) Inventory of U.S. Greenhouse Gas Emissions and Sinks: 1990-2013, Annex 3 Methodological Descriptions for Additional Source or Sink Categories.

EPA (2021) Inventory of U.S. Greenhouse Gas Emissions and Sinks: 1990-2019, Annex 3 Methodological Descriptions for Additional Source or Sink Categories.

EPA The Greenchill Advanced Refrigeration Partnership; http://www2.epa.gov/sites/production/files/2013-08/documents/greenchill_store_certification_program_guidance_7.29.13.pdf; <http://www2.epa.gov/greenchill/greenchill-store-certification-awards>; “Small system data 2008 – 2017”.

ICF (2016) Accounting Tool to Support Federal Reporting of Hydrofluorocarbon Emissions: Supporting Documentation.

ICF (2009) The U.S. Phaseout of HCFCs: Projected Servicing Needs in the Air Conditioning and Refrigeration Sector. Prepared for the U.S. EPA by ICF International.

IPCC (2006) Guidelines for GHG Inventories, Volume 3: Industrial Processes and Product Use; Chapter 7 Emissions of Fluorinated Substitutes for Ozone Depleting Substances.

IPCC (2007) Climate Change 2007, Synthesis Report. International Panel on Climate Change, World Meteorological Organization, United Nations Environment Programme.

RTOC (2010) Refrigeration, Air Conditioning and Heat Pumps Technical Options Committee, 2010 Assessment, United Nations Environment Programme.

P&S Market Research: “Range of Charge Sizes for Self-Contained Refrigeration Units”, December 2016.